

ΗР

NetServer Rack

Configuration

Evolving a higher level of protection



NetServer Rack Configuration Guide

This configuration guide is intended to allow you to:

- Calculate the power requirements, weight and stability of your rack solution
- Determine the number of racks required to rackmount your equipment
- Identify the key features of racks and accessory products
- Generate a complete custom list of rack and accessories required

HP strongly recommends the use of the HP NetServer Rack Assistant configuration software to configure your rack solution. This free tool is available from the world wide web at http://www.hp.com/go/netserver

If, for any reason, you are not able to use the Rack Assistant software, follow the steps below to create your custom rack solution. For details of each step, see the Configuration Details on pages 12 and 13.



Total the EIA units required for all equipment*

Using the EIA total, determine the rack size(s) and quantity needed

Fill in the selection list on the following page with items identified in this shaded area.

Calculate the power requirements*

Identify the PDU(s) and cord sets required

Calculate the total equipment weight*

Identify the amount of ballast recommended

Choose the /E or /U rack line

Identify sizes and quantity from chosen rack line

Choose additional items to complete your rack solution

Identify additional items:
• Rack delivery services

- Front doors
- Tie kits
- Side panel kits
- Switchboxes
- Rackmount kits
- Accessories



* See Calculation Configuration Table — page 15

Selection list is complete -

place order

Product information is also available at:

http://www.hp.com/go/enclosures

Rack System Selection List for NetServers

| | | Description | Product Number | Quantity | For details, see page |
|-----------------|------------|--|---------------------|----------|-----------------------|
| HP Rack Syste | em Model | HP Rack System/E41 | J1500A | | 4 |
| | | HP Rack System/E33 | J1501A | | 4 |
| | | HP Rack System/E25 | J1502A | | 4 |
| | | HP Rack System/U33 | J1466A | | 5 |
| | | HP Rack System/U25 | J1464A | | 5 |
| Delivery Servi | ices | Inside delivery service | J1543A | | 4 |
| • | | Coordinated shipment service | J1544A | | 5 |
| Front Doors | | Front door for /E41 | J1509A | | 6 |
| | | Front door for /E33 or /U33 | J1510A | | 6 |
| | | Front door for /E25 or /U25 | J1511A | | 6 |
| Tie Kits | | Tie Kit for /E41 | J1512A | | 6 |
| no mis | | Tie Kit for /E33 or /U33 | J1513A | | 6 |
| Side Panel Kit | te | Sido papal kit for /E/11 | 11504 0 | | 4 |
| Side Pariei Kit | ıs | Side panel kit for /E41 Side panel kit for /E33 | J1506A J1507A | | 6 6 |
| | | Side panel kit for /E25 | J1508A | | 6 |
| Dawer Dietrik | ution | · | | | |
| Power Distrib | | | | | |
| F | PDUs | 100-240V, 10 amps | E7670A | | 7 |
| | | 100-240V, 16 amps | E7671A | | 7 |
| | | Bundle (1 ea. E7670A, E7671A, E7742A) 100-240V, 16 amps | E7672A E7674A | | 7 7 |
| | | 100-127V, 16 amps | E7675A | | 7 |
| | | 100-240V, 16 amps | E7676A | | 7 |
| _ | Cord Sets | 100-127V NEMA (to wall), C19 to 5-20P | E7802A | | 7 |
| | Joi u Jets | 200-240V IEC (to wall or UPS), C19 to L6-20P | E7803A | | 7 |
| | | 100-240V IEC (to server, storage or UPS), C19 to C2 | | | 7 |
| | | 200-240V IEC (to UPS), C19 to L6-30P | E7805A | | 7 |
| | | 100-240V (to wall or UPS), C19 to unterminated | | | 7 |
| | | 250V IEC for LX Pro/Lxe Pro (to server, storage or UPS), C14 to C15 | E7807A | | 7 |
| | | 240V IEC (to European wall), C19 to IEC309 | E7808A | | 7 |
| | | 240V IEC (to European wall), C19 to CEE7/7 | E7809A | | 7 |
| | | 240V IEC (to server, storage or UPS), C13 to C14 | E7742A | | 7 |
| | | 127V NEMA (to server, storage or UPS), C13 to 5-15P | E7743A | | 7 |
| | | 240V IEC (to server, storage or UPS) | E7798A | | 7 |
| | | | | | |
| Switchboxes | | 4-port switchbox, plus 4 cable sets 8-port switchbox, plus 8 cable sets | J1493B J1497B | | 9 9 |
| | | o-poi i switchbox, plus o cable sets | J 1477D | | 7 |
| Rackmount Ki | ts | | | | |
| ī | Jniversal | Keyboard rackmount kit | J1518A | | 8 |
| | | Monitor rackmount kit | J1519A | | 8 |
| | | Plain shelf rackmount kit | J1520A | | 8 |
| S | Servers | NetServer LXr Pro Conversion Kit* | J1523A | | 9 |
| | | NetServer LX/LXe | J1455B | | 9 |
| | | NetServer LCII | J1456B | | 9 |
| | | NetServer E Rackmount kit included with product | J1496C | | 9 |
| | | NetServer LH 3r | Included | | |
| | | NetServer LXr Pro and LXr Pro8 | Included | | |
| 5 | Storage | NetServer Storage System/6 | J1492B | | 9 |
| J | Juliage | Rackmount kit included with product | J 17/2D | | 7 |
| | | NetServer Storage System/8 | Included or C2788B* | | 9 |
| | | HP SureStore DLT Library 4115r and 4215r | Included | | |
| Accessories | | Computer rails | C2788B | | 9 |
| 0003301103 | | Ballast | C2790A | | 10 |
| | | Filler panels (qty 6) | J1514A | | 10 |
| | | Cable guide (qty 2) | E7723B | | 10 |
| | | Mounting hardware | J1522A | | 11 |
| | | Lift hooks (qty 4) Rail spacers (qty 4) | J1521A J1516A | | 11 11 |
| | | naii spaceis (4ty 4) | JIJIUM | | 11 |

^{*}Needed only to mount in Rack System/E or Rack System/U

HP Rack System/E

Advanced, full-featured rack for the most demanding rackmount requirements. Electronic Industry Association (EIA) standard compliant.

Key Features

- Extendible top allows for an additional 8U of vertical space to be added to an existing rack
- Optimum ventilation including perforated rear door and fully perforated top
- Ships and moves fully integrated, up to 1800 lbs.
- Retractable anti-tip foot extends from front or rear
- Numbered columns for easy integration
- Available in three sizes: 41U, 33U, 25U

Features


- 1 Fully perforated top
- 2 Lockable perforated rear door, 63% airflow
- 3 Numbered columns (numbered from bottom to top)
- 4 Bi-directional, retractable anti-tip foot
- 5 Casters
- **6** Leveling feet
- 7 Solid base


Optional

- 8 Modular side panels
- 9 Lift hooks
- **10** Filler panels
- 11 Perforated front door, 63% airflow
- 12 Ballast

Use the Rack System/E when **you want:**

- Maximum configuration flexibility
- To mount equipment up to 2000 lbs.
- Vertical extension capability to an existing rack



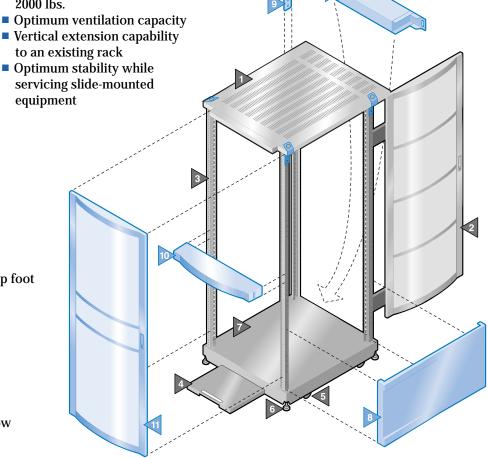

| Product Numbers | | J1500A | J1501A | J1502A |
|------------------------|--|---|---|--|
| EIA Units | | 41U | 33U | 25U |
| Caster rating | | 1000 lbs per caster | 1000 lbs per caster | 1000 lbs per caster |
| Color | Top and rear door Columns and base | Quartz gray Slate gray | Quartz gray Slate gray | Quartz gray Slate gray |
| Weight | Empty rack Packaged Rear door | 73.5 kg (162 lbs) 142.4 kg (314 lbs) 13.2 kg (29 lbs) | 69 kg (153 lbs) 132.9 kg (293 lbs) 12.7 kg (28 lbs) | 65 kg (144 lbs) 124.3 kg (274 lbs) 8.6 kg (19 lbs) |
| Dimensions | Rack (w x d x h) Rack packaged (w x d x h) | 23.5 in x 36.5 in x 77.5 in 40 in x 48 in x 86.5 in | 23.5 in x 36.5 in x 63.5 in 40 in x 48 in x 72.5 in | 23.5 in x 36.5 in x 49.5 in 40 in x 48 in x 58.5 in |

Delivery Services

J1543A Inside Delivery Service—Available in the US only

Provides for delivery of rack to the installation site at the specified shipping address and removal of packaging materials upon customer's request. Order one part number per rack. 1-2 week delivery time.

HP Rack System/U

Utility rack for basic rackmounting needs. Electronic Industry Association (EIA) standard compliant.

Key Features

- Ships and moves fully integrated, up to 1000 lbs.
- Numbered columns for easy integrationAdequate ventilation for NetServer systems
- One-piece removable side panels
- Perforated rear door, solid top
- Bolt-on anti-tip foot
- Available in two sizes: 33U, 25U

Use the Rack System/U when you want:


- Basic rack features
- To mount equipment with no special ventilation requirements

Features

- 1 Solid top
- 2 Lockable perforated rear door, 63% airflow
- 3 Numbered columns (numbered from bottom to top)
- 4 Bolt-on anti-tip foot
- 5 Side panels
- 6 Casters
- 7 Leveling feet
- 8 Solid base
- 9 Cable guide

Optional

- 10 Filler panels
- 11 Ballast
- 12 Perforated front door, 63% airflow

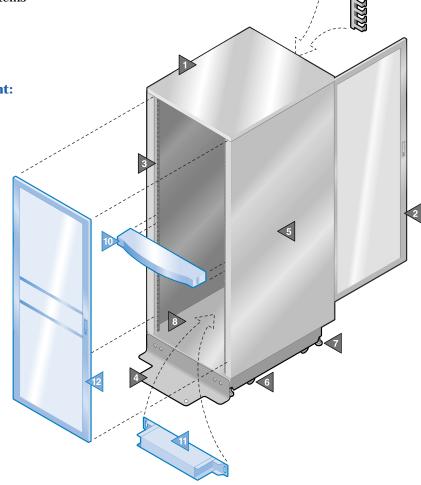

| Product Numbers | s | J1466A | J1464A |
|-----------------|--|--|--|
| EIA Units | | 33U | 25U |
| Caster rating | | 225 lbs per caster | 225 lbs per caster |
| Color | Top cap, columns, side panels and rear door | Quartz gray | Quartz gray |
| Weight | Empty rack Packaged Rear door Side panels | 101.2 kg (223 lbs) 116.6 kg (257 lbs) 8.6 kg (19 lbs) 17.2 kg (38 lbs) | 84.4 kg (186 lbs) 108 kg (238 lbs) 7.6 kg (16 lbs) 12.7 kg (28 lbs) |
| Dimensions | Rack (w x d x h) Rack packaged (w x d x h) | 23.4 in x 36.5 in x 63.2 in 40 in x 48 in x 72.5 in | 23.4 in x 36.5 in x 49.2 in 40 in x 48 in x 58.5 in |

J1544A Coordinated Shipment Delivery Service—Available in the US only

Provides for rack and accessories to arrive within a 3-day period of each other at the customer location. Accessories will arrive boxed together in one shipment. Order one part number per order. 1–2 week delivery time.


Front Doors Key Features

- Perforated, 63% airflow
- Lockable latch for equipment security
- All equipment is visible through the perforations
- Mounting hardware included

Use a front door to:

- Secure equipment from unwelcome access
- Provide a clean aesthetic finish to the rack





Perforation Material

| Product No. | Use with |
|-------------|---------------|
| J1509A | /E41 |
| J1510A | /E33 and /U33 |
| J1511A | /E25 and /U25 |

Front Doors

Tie Kits Key Features

- Easily installed without removing or turning off rackmounted equipment
- Can connect racks of different sizes together (41U and 33U)
- Can connect /E and /U racks together
- Increases security of equipment by reducing side access
- Mounting hardware included

Use a tie kit to:

Connect two or more racks together



Tie Kit Contents

| Product No. | Use with | |
|-------------|---------------|---|
| J1512A | /E41 | |
| J1513A | /E33 and /U33 | • |

This tie kit can also be used to connect the /E41 with either an /E33 or /U33.

Side Panels


Use only with the Rack System/E

Key Features

- Snap on/off design, requires no tools for installation or removal
- Kits contain the panels needed to cover both sides of the rack
- Only one side panel kit is required for a tied together rack configuration

Use side panels to:

- Gain easy side access just where you need it. Security is maintained if a front and rear are installed
- Provide a finished clean look to the rack solution



/E25 Side Panel Kit



/E25 Side Panels Installed

| Product No. | Use with* | Kit contains |
|-------------|-----------|--|
| J1506A | /E41 | Qty: 2 9U side panels, Qty: 8 8U side panels |
| J1507A | /E33 | Oty: 2 9U side panels, Oty: 6 8U side panels |
| J1508A | /E25 | Oty: 2 9U side panels, Oty: 4 8U side panels |
| | | |

 $^{^{\}star}$ Side panels come standard with the Rack System/U

Modular Power Distribution Units (PDUs) Key Features

- Up to four PDUs per rack
- Mounting hardware included
- Can be mounted vertically or horizontally on columns

Use a PDU to:

Conveniently provide power to rackmounted equipment








E7672A Contents



Plugs





Outlets Inlets

PDUs

| Product Number | Voltage | Max Current | Outlets | Inlets | Certification |
|-------------------------------|---------------------------|--------------------|---|------------------------------|--------------------------------|
| E7670A | 100-240 (Univ) | 10 amps | 10 IEC320 C13 | 1 IEC320 C14 | UL, C-UL, TUV-R GS |
| E7671A | 100-240 (Univ) | 16 amps | 6 IEC320 C13, 2 IEC320 C19 | 1 IEC320 C20 | UL, C-UL, TUV-R GS |
| E7672A* | 100-240 (Univ) | 16 amps | 16 IEC320 C13, 2 IEC320 C19 | 1 IEC320 C20 | UL, C-UL, TUV-R GS |
| E7674A E7675A [†] | 100-240 (Univ) | 16 amps | 7 IEC320 C13, 1 IEC320 C19 | 1 IEC320 C20 1 IEC320 C20 | UL, C-UL, TUV-R GS |
| E7676A | 100-127 100-240 (Univ) | 16 amps 16 amps | 9 NEMA 5-15R, 1 IEC320 C13 10 IEC320 C13 | 1 IEC320 C20 1 IEC320 C20 | UL, C-UL UL, C-UL, TUV-R GS |

^{*} E7672A is a bundled set of 1ea. E7670A, E7671A and E7742A jumper cable.

Cords Sets

| Product Number | Туре | Cord Length | Plug | Compatible APC UPS ** |
|-------------------|---|----------------|---------------------|--------------------------|
| E7802A | 100-127V NEMA (to wall) | 4.5m (177.2in) | C19 to 5-20P | NS2200RM3U |
| E7803A | 200-240V IEC (to wall or UPS) | 4.5m (177.2in) | C19 to L6-20P | NS3000RMT3U |
| E7804A | 100-240V IEC (to server, storage or UPS) | 4.0m (157.5in) | C19 to C20 | NS2200RMI3U |
| E7805A | 200-240V IEC (to UPS) | 4.5m (177.2in) | C19 to L6-30P | _ |
| E7806A | 100-240V IEC (to wall or UPS) | 4.5m (177.2in) | C19 to unterminated | _ |
| E7807A | 250V IEC for LX Pro/Lxe Pro (to server, storage or UPS) | 0.76m (29.9in) | C14 to C15 | _ |
| E7808A | 240V IEC (to European wall) | 4.5m (177.2in) | C19 to IEC309 | _ |
| E7809A | 240V IEC (to European wall) | 4.5m (177.2in) | C19 to CEE7/7 | _ |
| E7742A | 240V IEC (to server, storage or UPS) | 2.5m (98.4in) | C13 to C14 | _ |
| E7743A | 127V NEMA (to server, storage or UPS) | 2.5m (98.4in) | C13 to 5-15P | _ |
| E7798A | 240V IEC (to server, storage or UPS) | 2.5m (98.4in) | C19 to C20 | |

^{**} APC UPS products are sold and supported by APC and APC resellers (not orderable from HP).

[†] For 110V environments, HP recommends the use of the E7675A PDU because NetServers ship with a power jumper cable compatible with E7675A receptacles.

Universal Rackmount Kits

Keyboard Rackmount Kit Key Features

- Retracts into the rack when not in use
- Easy installation
- Fits all standard keyboards
- Mounting hardware included

Use the keyboard kit to:

Mount a keyboard and mouse within a rack

Note: These kits do not include a keyboard or mouse.




- Snap-in design
- **■** Easy installation
- Mounting hardware included

Use the monitor rackmount kit to:

■ Mount a 14"-19" monitor within a rack




J1518A Installed in Rack




Keyboard Rackmount Kit Contents

| Product No. | Use with | Kit contains | EIA Units |
|-------------|--------------|---|-----------|
| J1518A | All HP Racks | Keyboard kit assembly, mounting hardware | 2 |



J1519A Installed in Rack



Monitor Rackmount Kit Contents


| Product No. | Use with | Kit contains | EIA Units |
|-------------|--------------|------------------------------------|-----------|
| J1519A | All HP Racks | Monitor base, snap-in front bezel, | 11 |
| | | mounting hardware | |

Plain Shelf Key Features


- Supports up to 68 kg (150 lbs)
- Easy installation
- Mounting hardware included
- Attractive quartz color

Use a shelf to:

 Provide a stationary surface in a rack for products without a custom rackmount kit.



J1520A Installed in Rack



Shelf Contents

| Product No. | Use with | Kit contains | EIA Units |
|-------------|--------------|-------------------------------------|-----------|
| J1520A | All HP Racks | Stationary shelf, mounting hardware | 1 |

Server Rackmount Kits Key Features

- Designed to custom fit the server
- Mounting hardware included
- Easy installation

Use the server rackmount kit to:

■ Mount a server in a rack



LH 3r Installed in Rack



J1455B Rackmount Kit Contents

| Product No. | Use with | Rackmounted server | EIA Units |
|------------------|--------------------------------|-------------------------|-----------|
| J1455B | All HP Racks | LX Pro/LXe Pro | 14 |
| J1456B | All HP Racks | LC II | 14 |
| J1496C | All HP Racks | E Series | 11 |
| J1523A | Only for /E and /U line | LXr Pro | 7 |
| Rackmount kit is | bundled with server, no separa | ate purchase necessary. | |
| | All HP Racks | LH 3r | 8 |
| | All HP Racks | LXr Pro8 | 10 |

Storage Rackmount Kits Key Features

- Designed to custom fit the storage system
- Mounting hardware included
- Easy installation

Use the storage rackmount kit to:

Mount a storage system in a rack





C2788B Contents

J1492B Contents

| Product No. | Use with | Rackmounted Storage System | EIA Units |
|------------------|------------------------------|----------------------------|-----------|
| J1492B | All HP Racks | Storage System/6 | 11 |
| C2788B | Only for /E and /U line | Storage System/8 | 3 |
| Needed only to r | mount in Rack System /E or R | ackSystem /Ū | |

Switchboxes Key Features

- Available in 4-port and 8-port models
- Appropriate quantity of 3.66m (12 ft) cable sets are included
- Software controlled

Use a switchbox to:

 Control multiple NetServers from a single monitor, keyboard and mouse



J1493B Kit Contents



J1497B Kit Contents

| Product No. | Description | Use with | Kit contains | EIA Units |
|-------------|-----------------------------|--------------|---|--|
| J1493B | 4-port console switchbox | All HP racks | 4-port switchbox, 4 sets of mouse, keyboard, and monitor cables and mounting hardware | 1 unit – front mount; 0 unit – rear mount |
| J1497B | 8-port console switchbox | All HP racks | 8-port switchbox, 8 sets of mouse, keyboard, and monitor cables and mounting hardware | 1 unit – front mount; 0 unit – rear mount |

Ballast Key Features

- Mounts easily to the rear columns
- Mounting hardware included

Use ballast to:

 Provide an added measure of stability for servicing slide-mounted equipment.



C2790A Installed in Rack

| Product No. | Use with | Kit contains |
|-------------|--------------|---|
| C2790A | All HP Racks | 30 lb. steel ballast, mounting hardware |

Filler Panels Key Features

- Easy snap-in design
- **■** Contemporary industrial design
- No mounting hardware required

Use filler panels to:

Attractively cover unused rack space.



Filler panels

| Product No. | Use with | Kit contains | EIA Units |
|-------------|----------------------|-----------------|-----------------------------|
| J1514A | /E and /U racks only | 6 filler panels | 1 EIA unit per filler panel |

Cable Guide Key Features

- Sturdy 16-gauge metal will support heavy cables
- Mounts vertically or horizontally on rear columns
- Quick and easy installation

Use a cable guide to:

Organize routing of data and power cables



Cable Guide

| Product No. | Use with | Kit contains |
|-------------|--------------|---------------------------------------|
| E7723B | All HP Racks | 2 19" cable guides, mounting hardware |

Accessories (continued)

Lift Hooks Key Features

- Each hook can support 500 lbs.
- Easy installation
- No additional hardware required

Use lift hooks to:

Lift a rack weighing up to 2000 lbs. for repositioning



J1521A Installed on Rack



Lift Hooks

| Product No. | Use with | Kit contains | |
|-------------|--------------------|--------------|--|
| J1521A | Rack System/E only | 4 lift hooks | |

Rail Spacers

The Rack System/E and /U design includes a recess of 1/2 inch on the inside mounting surface of each column to support mounting full-width products. Spacers are used with old legacy rackmount kits to fill the 1/2 inch recess gap.

Key Features

- Die-cast aluminum construction
- Mounting hardware included

Use spacers to:

 Accommodate legacy rackmount kits in the HP Rack System/E and /U.



Spacers

| Product No. | Use with | Kit contains | Use wit | h old legacy products |
|-------------|-------------------------------|--|---------|---|
| J1516A | Rack System /E and /U only | 2 left spacers, 2 right spacers, mounting hardware | J1492A | NetServer E rackmount kit NetServer SS/5 rackmount kit NetServer LCII rackmount kit |

Hardware Use extra hardware to:

Keep extra mounting hardware at hand



Hardware

| J1522A All HP racks and rack non-decorative screws with lock washers, 20 U-type accessories sheet metal nuts | Product No. | Use with | Kit contains |
|--|-------------|----------|---|
| | J1522A | and rack | non-decorative screws with lock washers, 20 U-type, |

Configuration Details

Generate a complete list of products to be rackmounted.

Don't leave anything out. If you know you'll be using more than 1 rack, list the items to be included in each rack.

2

Determine the EIA units required for all equipment.

Each rack has a specific amount of vertical mounting space which is measured in EIA units (1 EIA unit is equal to 1.75 inches or 45.44 mm). The rack title is indicative of this measurement (i.e., Rack System/E25 has 25 EIA units of vertical mounting space). Using the Calculation Configuration table on page 15, list the EIA units required for each product listed in step 1.

If there is a product to be rackmounted not listed on page 15, rackmount it on a plain shelf. In this case, calculate the height of the product into EIA units (1 = 1.75 in or 44.45 mm) and add 1 additional EIA unit for the height of the shelf. Add together the EIA units required for your rack solution.

3

Determine the rack size(s) and quantity needed.

- Up to 25U: choose either the Rack System/E25 or the Rack System/U25
- 26U to 33U: choose either the Rack System/E33 or Rack System/U33
- 33U to 41U: choose the Rack System/E41
- More than 41U: any combination of the /E25, /E33, /E41 or /U25, /U33 (Note: You can mix and even tie-together, the /E and /U lines. However, these lines do not have the same look and the rack solution aesthetics will be compromised.)

Note on multiple racks:

If multiple racks are required, you may want to connect them with a tie-together kit. Make sure to use the appropriate size tie kit. A 33U tie kit can connect a 41U and a 33U together. No tie kit is available for a 25U rack.



Calculate the power requirements.

The PDU is a rackmounted power strip with multiple power receptacles. Rack components are plugged into PDU receptacles. The number of components placed in a rack impacts the quantity of power distribution units required and is affected by:

- facility power voltage (100-120V or 200-240V)
- number of power receptacles needed
- mounted equipment current (Amperes)
- 1. Determine the facility power voltage that will be used.
- Count the quantity of receptacles needed from the PDU(s). (The Rack Storage/8 and Rack Storage/12 requires 2 power receptacles)
- 3. Total the Amperes required for all components in each rack.

(use the Configuration Calculation table on page 15 for this information) The total amperes of devices plugged into a PDU cannot exceed the 10A or 16A rating of the PDU. When the 10A PDU is plugged into the 16A PDU, the total current of the two PDUs cannot exceed 16A. If the result is greater than the maximum PDU amperage, order an additional PDU. Amperage can be determined using the following formula (For 110V current, use 104 as the adjusted voltage. For 208V current, use 180. For 230V current, use 198.)

See Configuration Calculation table on page 15 for watts.

- 4. Determine the PDU(s) and cord sets.
- Using the table on page 7, find the appropriate PDU which is determined by the voltage and number receptacles required for the rack solution (per rack).
- A list of cord sets is also available on page 7. Choose the power cord with the appropriate plug attached (to choose the correct plug, you must know the type of wall/UPS receptacle to be used).
- Jumper cables are not needed for rack-optimized products.

Note on multiple racks:

No power or calculations can be made between racks. Calculating total power requirements does not allow for cross connecting power between racks. Cross connecting power between racks could pose a serious threat of injury to personnel or damage to components.




Calculate the total equipment weight.

All racks come with an anti-tip foot for temporary servicing. Ballast offers additional security in case someone forgets to use the anti-tip foot. The calculations below recommend the number of ballasts to buy to prevent tipping if all slide-mounted products are extended at the same time.

Configuration Details


Weight and Balance Worksheet:

1. Total the weight of operator serviceable slide-mounted products:



2. Total the weight of all fixed and trained service personnel serviceable products:

3. Calculate the moment for both totals (M1 and M2) from above:




M1 = Moment on rack with all operator serviceable slide-mounted products extended. M2 = Moment of all fixed and trained personnel serviceable slide-mounted products and rack. M2 moment calculations assume a 1.00 ft center of gravity for installed products

If M1 is less than or equal to M2, no additional counter weight is needed.

If M1 is greater than M2, use the formulas below to determine the required counter weight.

Force (in lbs) = (M1 – M2) ft-lbs ÷ 2.46 ft = amount of force required @ 2.46 ft X = Force (lbs) \div 30 lbs = number of C2790A 30 lbs ballast kits to install, where "X" is rounded up to the next highest integer, e.g., 1.2 = 2 ballast kits.

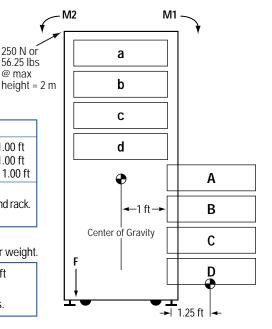

Note: You may choose not to install ballast weights if only trained service personnel will perform service, if the anti-tip foot is used during servicing or installation, and not more the one device is extended from the rack at any time.

250 N or

@ max

If using ballast, fill in the selection list on page 3 with the calculated number of ballast required.

Stability: Weight is a consideration when stacking the rack. In general, place the heaviest devices near the bottom of the rack for greatest stability and servicing. Put lighter devices and seldom accessed devices (such as monitors and rack-optimized storage modules) near the top of the rack.



Choose between the /E or /U rack line.

Choose the Rack System/E if you answer 'yes' to any of the following questions:

- Will you need to ship rack integrated?
- Do you want the option to increase the rack space by 8U for future growth?
- Is the equipment to be mounted over 1000 lbs.?
- Do you want optimum stability while servicing slide-mounted equipment?
- Do you require between 33U and 41U of vertical mounting space in a single rack?
- Does your equipment require optimum ventilation?

If you did not answer 'yes' to ANY of the above questions, remember the /E line is a full-featured, premium line while the /U line is a basic, utility rack line with limited configuration choices. See pages

4 and 5 for more differentiating details. Fill in the selection list on page 3 with the rack sizes and quantity.



Determine all additional items required.

When applicable, choose the appropriate size. (See the appropriate page for features.)

Fill in the Selection list on page 3 with the quantity of all additional items:

- Delivery services pages 4 and 5
- Front doors page 6
- Tie kits page 6
- Side panel kits (/E line only) page 6
- PDUs page 7

- Cord sets page 7
- Switchboxes page 7
- Rackmount kits page 8
- Accessories pages 9–10




Double check your list.


Go back through your notes and make sure all quantities have been included into the selection list on page 3.

Congratulations! You're now ready to place your order.

Rack System/E

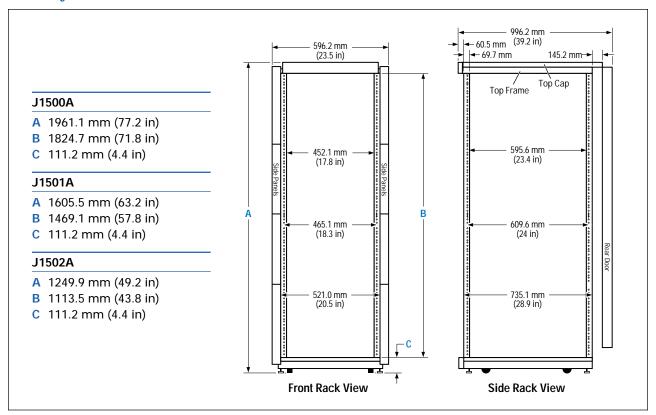

Rack System/U

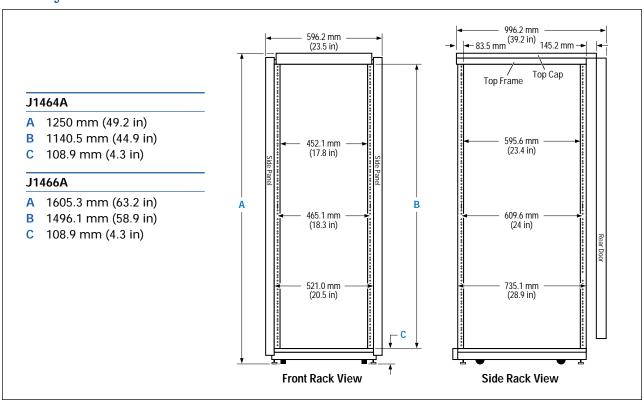

NetServer Configuration Calculation Table

| | Product Number | Description | EIA Units | Wt (lbs) | VA | Watts | Rackmount Kit Required* |
|----------------|-------------------|---|--------------|-------------|------|-------|----------------------------|
| Servers | | HP NetServer LH 3r | 8 | 150 | 632 | 638 | Included |
| | | HP NetServer LXr Pro8 | 10 | 170 | 980 | 989 | Included |
| | | HP NetServer LXr Pro | 7 | 90 | 450 | 446 | J1523A(1) |
| | | HP NetServer LX Pro/LXe Pro | 14 | 187 | 1455 | 1225 | J1455B |
| | | HP NetServer LHII/LH Pro/LD Pro | 11 | 70 | 715 | 735 | J1491B |
| | | HP NetServer LCII | 14 | 55 | 505 | 301 | J1456B |
| | | HP NetServer E | 11 | 32 | 245 | 172 | J1496C |
| Storage | D4902A | Storage System/8 | 3 | 80.5 | 211 | | Included or C2788B(1 |
| | D3604B | Storage System/6 | 11 | 36 | 480 | | J1492B |
| | C1556A, C1559A | HP SureStore DAT24e, 24GB | 3 | 4.8 | 6 | | _ |
| | C6280F | HP SureStore Autoloader 418 | 5 | 41 | 214 | | |
| | | HP SureStore DLT Mechanism (40e/70e) | 3 | 14.6 | 50 | | C6287J |
| | | HP SureStore DLT Library | 8 | 97 | 257 | | Included |
| UPS | NS2200RM3U | APC Smart-UPS 2200NS, | 3 | 102 | N/A | 1600 | Included |
| | | 120V (Available only through APC) | | | | | |
| | NS2200RMI3U | APC Smart-UPS 2200NS, | 3 | 102 | N/A | 1600 | Included |
| | | 230V (Available only through APC) | | | | | |
| | NS3000RMI3U | APC Smart-UPS 3000NS, | 3 | 112 | N/A | 2250 | Included |
| | | 230V (Available only through APC) | | | | | |
| | NS3000RMT3U | APC Smart-UPS 3000NS, | 3 | 112 | N/A | 2250 | Included |
| | | 208V (Available only through APC) | | | | | |
| Accessories | Up to 19" | Monitor | 11 | 30 | 125 | | J1519A |
| | Any | Keyboard | 2 | 10 | | | J1518A |
| | J1493A | Switchbox 4-port | 0 or 1 | 12 | 100 | | Included |
| | J1497A | Switchbox 8-port | 0 or 1 | 12 | 100 | | Included |
| Hubs & Routers | 28673A | HP 10:10 LAN Bridge | 1 | 6 | 96 | 48 | Included |
| | 28682A | HP Fiber-Optic Hub Plus | 1 | 6 | 96 | 48 | Included |
| | 28688B | HP EtherTwist Hub Plus | 1 | 6 | 96 | 48 | Included |
| | J2413A | HP AdvanceStack 100VG Hub-7m | 2 | 10 | 144 | 86 | Included |
| | J2415A | HP AdvanceStack 100VG Hub-14 | 2 | 10 | 144 | 86 | Included |
| | J2601B | HP AdvanceStack 10Base-T Hub-24 | 2 | 9 | 144 | 86 | Included |
| | J2611B | HP AdvanceStack 10Base-T Hub-16U | 1 | 5 | 48 | 24 | Included |
| | J2962A | HP AdvanceStack Power Supply | 3 | 22 | 1200 | 720 | Included |
| | J3100B | HP AdvanceStack Switch 2000 | 7 | 20 | 360 | 216 | Included |
| | J3125A | HP AdvanceStack Switch 200 | 1 | 10 | 96 | 48 | Included |
| | J3135A | HP AdvanceStack 10Base-T Hub-16U Bundle | 1 | 5 | 48 | 24 | Included |
| | J3175A | HP AdvanceStack Switch 208 with 100BaseTX | 2 | 6 | 192 | 115 | Included |
| | <u>J</u> 3177A | HP AdvanceStack Switch 224 with 100BaseTX | 2 | 9 | 192 | 115 | Included |
| | J3200A | HP AdvanceStack 10BT S Hub-12R | 2 | 9 | 144 | 86 | Included |
| | J3201A | HP AdvanceStack S Hub-12R w/Mgmt | 2 | 9 | 144 | 86 | Included |
| | J3202A | HP AdvanceStack 10BT S Hub-24R | 2 | 9 | 144 | 86 | Included |
| | J3203A | HP AdvanceStack S Hub-24R w/Mgmt | 2 | 9 | 144 | 86 | Included |
| | J3204A | HP AdvanceStack S Hub-24T | 2 | 9 | 144 | 86 | Included |
| | J3205A | HP AdvanceStack S Hub-24T | 2 | 9 | 144 | 86 | Included |
| | J3231A | HP Remote 2C and Internet Router Bundle | 2 | 10 | 180 | 90 | Included |
| | J3245A | HP AdvanceStack Switch 800T | 2 | 10 | 190 | 101 | Included |

^{*} Included = Rackmount kit is included with the equipment purchase;

^{— =} no custom rackmount kit available, use a plain shelf (J1520A)

⁽¹⁾ Needed only when rackmounting in the Rack System/E or $\mbox{/U}$



Technical information in this document is subject to change without notice.

© Copyright Hewlett-Packard Company 1998. All Rights Reserved. Reproduction, adaptation, or translation without prior written permission is prohibited, except as allowed under the copyright laws.

Update Information

Last Electronic Update — 4/99 Last Printed Update — 4/99

5968-0156E

